

LAPORAN PEKERJAAN



PEMELIHARAAN PERANGKAT PENDUKUNG
DATA CENTER DAN DRC
BADAN KEPEGAWAIAN NEGARA

Jakarta, 31 Januari 2024

No : 001/SP-AI/Per-BKN/I/2024
Perihal : Permohonan Pemeriksaan Pekerjaan
Lampiran : -

Kepada Yth,
Pejabat Pembuat Komitmen
Pada Direktorat Infrastruktur Teknologi Informasi
Badan Kepegawaian Negara
Jl. May.Jend. Sutoyo No. 12
Jakaria Timur

Dengan Hormat,
Sesuai dengan Surat Perintah Kerja (SPK) Pelaksanaan Pekerjaan Pemeliharaan Perangkat Pendukung Data Center dan DRC Direktorat Infrastruktur Teknologi Informasi bulan Januari Tahun 2024 Nomor : 01/SPK/DIT.INTI/I/2024 tanggal 2 Januari 2024, bersama ini Kami sampaikan bahwa pelaksanaan pekerjaan tersebut telah selesai kami laksanakan. Seperti hal tersebut diatas kami mohonkan untuk diadakan pemeriksaan hasil pekerjaan tersebut.

Demikian Surat Permohonan ini kami sampaikan untuk dapat dipergunakan sebagaimana mestinya. Atas perhatiannya kami ucapkan terima kasih.

Hormat Kami,
PT. Arasis Infirco



Zulkirman
Direktur Utama

Jakarta, 31 Januari 2024

No : 002/SP-AI/Per-BKN/I/2024
Perihal : Laporan Pemeliharaan Perangkat Pendukung Data Center dan DRC
Direktorat Infrastruktur Teknologi Informasi BKN
Bulan Januari 2024
Lampiran : Rincian Laporan Pelaksanaan Pekerjaan

Kepada Yth,
Pejabat Pembuat Komitmen
Pada Direktorat Infrastruktur Teknologi Informasi
Badan Kepegawaian Negara
Jl. May.Jend. Sutoyo No. 12
Jakarta Timur

Dengan Hormat,
Sesuai dengan Surat Perintah Kerja (SPK) Pelaksanaan Pekerjaan Pemeliharaan Perangkat Pendukung Data Center dan DRC Direktorat Infrastruktur Teknologi Informasi bulan Januari Tahun 2024 Nomor : 01/SPK/DIT.INTI/I/2024 tanggal 2 Januari 2024, bersama ini Kami sampaikan laporan pekerjaan tersebut dengan rincian kegiatan pelaksanaan yang telah kami lakukan.

Demikian laporan ini kami sampaikan untuk dapat dipergunakan sebagaimana mestinya. Atas perhatiannya kami ucapkan terima kasih.

Hormat Kami,
PT. Arasis Infirco


ARASIS

Zulkirman
Direktur Utama

PT. Arasis Infirco

Gedung 47 Lantai 2
Jl. TB. Simatupang No. 47 Tanjung Barat - Jakarta Selatan 12530
Telp. 021.29406340, 021.22001381
www.arasis.web.id



SERVICE REPORT

Customer Name	Address
Phone Number	City/State/Zip
Service Request	Technician Name

Work Order Number	Priority	Technician
Customer Name	Address	City/State/Zip

DATA CENTER

Equipment ID	Location	Status
Manufacturer	Model	Serial Number
Power Supply	Temperature	Humidity
Network Port	IP Address	MAC Address
Uptime	Last Maintenance	Next Maintenance

Technician Signature	Date
Customer Signature	Date
Notes	Comments

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 01/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Datacenter</u>	
Date : <u>3/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Web Application Server Pusat 1	HP PROLIANT DL380G5	CZC9165ZRC

HARDWARE SPECIFICATION

ProLiant DL380 G5 Xeon Quad Core E5420 Rackmount 2U, 2 GB (2 x 1 GB) Advanced ECC Fully Buffered DDR-2 667MHz RAM, max 32GB
 4x2.50 GHz 64 bit cores / 12MB (2 x 6MB) cache/ 1333 MHz FSB
 Includes dual LAN NC373i 10/100/1000TX
 Redundant Power Supply 350/370/380 G5 Kit
 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm
 2 disks per server RAID1 Mirror, for operating system. Common applications are stored in SAN
 2 GB FBD PC2-5300 2 x 1 GB Dual Rank Kit
 4 GB FBD PC2-5300 2 x 2 GB Dual Rank Kit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
1	Check Operational	CPU	Ok	
		HDD	Ok	
		RAM	Ok	
2	Check hardware Fault / Led status	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative DEDDY DERMAWAN, S KOM NIP. 19911282018011002	SIS User Representatives NIP. 199307032013001	Service Engineer PT. Arasis Infirco
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 02/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Datacenter</u> Date : <u>3/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	--

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Web Application Server Pusat 2	HP PROLIANT DL380G5	CZC9160GK1

HARDWARE SPECIFICATION




ProLiant DL380 G5 Xeon Quad Core E5420 Rackmount 2U, 2 GB (2 x 1 GB) Advanced ECC Fully Buffered DDR-2 667MHz RAM, max 32GB
 4x2.50 GHz 64 bit cores / 12MB (2 x 6MB) cache/ 1333 MHz FSB
 Includes dual LAN NC373i 10/100/1000TX
 Redundant Power Supply 350/370/380 G5 Kit
 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm
 2 disks per server RAID1 Mirror, for operating system. Common applications are stored in SAN
 2 GB FBD PC2-5300 2 x 1 GB Dual Rank Kit
 4 GB FBD PC2-5300 2 x 2 GB Dual Rank Kit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customer's Representative  DEDDY DERMAWAN S KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  ELMAS SINOMBING NIP. 195507052013032	Service Engineer  ARASIS PT. Arasis Infirco
--	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 03/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name :
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	PEMELIHARAAN PERANGKAT
Location : <u>Gd. II Lt.11 R. Datacenter</u>	PENDUKUNG DATA CENTER DAN DRC
Date : <u>3/1/2024</u>	BADAN KEPEGAWAIAN NEGARA

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Web Application Server Pusat 3	HP PROLIANT DL380G5	CZC9166HC3

HARDWARE SPECIFICATION

ProLiant DL380 G5 Xeon Quad Core E5420 Rackmount 2U, 2 GB (2 x 1 GB) Advanced ECC Fully Buffered DDR-2 667MHz RAM, max 32GB
 4x2.50 GHz 64 bit cores / 12MB (2 x 6MB) cache/ 1333 MHz FSB
 Includes dual LAN NC373i 10/100/1000TX
 Redundant Power Supply 350/370/380 G5 Kit
 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm
 2 disks per server RAID1 Mirror, for operating system. Common applications are stored in SAN
 2 GB FBD PC2-5300 2 x 1 GB Dual Rank Kit
 4 GB FBD PC2-5300 2 x 2 GB Dual Rank Kit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customer's Representative DEDDY DERMAWAN, S KOM NIP. 19911282018011002	User Representatives PENGELOLA SISTEM DAN JARINGAN ELDA S SIHOMBING NIP. 199307082018032012	Service Engineer PT. Arasis Infirco
--	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 04/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Datacenter</u> Date : <u>3/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Web Application Server Pusat 4	HP PROLIANT DL380G5	CZC9165ZQJ

HARDWARE SPECIFICATION

Proliant DL380 G5 Xeon Quad Core E5420 Rackmount 2U, 2 GB (2 x 1 GB) Advanced ECC Fully Buffered DDR-2 667MHz RAM, max 32GB
 4x2.50 GHz 64 bit cores / 12MB (2 x 6MB) cache/ 1333 MHz FSB
 Includes dual LAN NC373i 10/100/1000TX
 Redundant Power Supply 350/370/380 G5 Kit
 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm
 2 disks per server RAID1 Mirror, for operating system. Common applications are stored in SAN
 2 GB FBD PC2-5300 2 x 1 GB Dual Rank Kit
 4 GB FBD PC2-5300 2 x 2 GB Dual Rank Kit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
1	Check Operational	CPU	Ok	
		HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative (<u>DEDDY DERMAWAN S KOM</u>) NIP. 19911282018011002	User Representatives MANAJEMEN SISTEM DAN JARINGAN (<u>ELWA S SIHOMBING</u>) NIP. 1998070620150322	Service Engineer (<u>PT. Arasis Infirco</u>)
---	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 05/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Datacenter</u>	
Date : <u>3/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Load Balancer	f5 BIG IP 4000	f5-wcqc-bxnu

HARDWARE SPECIFICATION	
L7 requests per second: 425K	
L4 connections per second: 150K	
L4 HTTP requests per second: 1.25M	
Maximum L4 concurrent connections: 10M	
Throughput: 10 Gbps L4/L7	
Included: 4,500 TPS (2K keys)	
8 Gbps bulk encryption*	
RAM 16 GB, 500 GB	

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Customers Representative (<u>DEDDY DEPRATIYAN S.P.</u>) NIP. 199111111111111111	PENGELOLA SISTEM DAN JARINGAN User Representatives (<u>ELINA S SIHOMBING</u>) NIP. 199307082015032002	Service Engineer (<u>PT. Arasis Infirco</u>)
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 06/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Datacenter</u> Date : <u>3/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Storage Backup	Tower ATX Server	




HARDWARE SPECIFICATION	
2 X INTEL® XEON® E5506. 4m cache 2.13 Ghz 4.80 GT/S Intel S5500 Based Server Class ATX 2 X 4 Gb DDR 2 PC5300R ECC REGISTERED 1 X SATA II 250GB for OS 2 x 8 TB WDC RED SATA3 for NAS Ware 2 x 2 TB WDC RED SATA 3 for NAS Ware iCUTE Case Server High Tower ATX	

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRAMATA KOMPUTER PERTAMA Authorized Customers Representative  DEDDY DERMAWAN, S.KOM (NIP. 19911282018011002)	PENGELOLA SISTEM DAN JARINGAN User Representatives  ELLINA S SIHOMBING (NIP. 199307082015062000)	Service Engineer  PT. Arasis Infirco
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 08/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Datacenter</u>	
Date : <u>3/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	WAS Ekinerja	HP Proliant DL380e G8	CN740100KD

HARDWARE SPECIFICATION

Intel Xeon E5-2400v.2 series (quad-core)
 2 x 4 GB 1600 MHz DDR-3 RDIMM
 Ultra slim DVD-ROM
 HDD SAS 300 GB 10k
 PSU 460 Watt

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	PENGELOLA User Representatives  ELLIA S SIROMBING NIP. 199307082018032002	Service Engineer  ARASIS YULIOT PT. Arasis Infirco
--	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 09/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Datacenter</u>	
Date : <u>3/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	DB Server Dell	Dell PowerEdge R730xd	44H9YC2


HARDWARE SPECIFICATION	
Intel Xeon E5-2600 v4 8 x 16 GB 2400 Mhz DDR-4 UDIMM 4 x 1Gb, 2 x 10Gb NIC 8 x HDD SAS 1,2 TB 10k 2 x PSU 1100 W	

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
1	Check Operational	CPU	Ok	
		HDD	Ok	
		RAM	Ok	
2	Check Hardware fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  DEDDY DERMAWAN, S KOM NIP. 19911282018011002	PENGELOLA User Representatives SISTEM DAN JARINGAN  ELIASE SIMONONG NIP. 199307082013003200	Service Engineer  YUSUF PT. Arasis Infirco
--	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 10/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>3/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	DB Server Dell	Dell PowerEdge R720xd	8RDPQ02




HARDWARE SPECIFICATION			
Intel Xeon E5-2600 v4 8 x 16 GB 2400 Mhz DDR-4 UDIMM 4 x 1Gb, 2 x 10Gb NIC 8 x HDD SAS 1,2 TB 10k 2 x PSU 1100 W			

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 3/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	PENGELOLA User Representatives SISTEM DAN SARINGAN  EVINA S. SIHOMBING NIP. 198307082615032022	Service Engineer  ARASIS YUSU PT. Arasis Infirco
---	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 11/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : 4/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Development	HP DL580G5	GB8917P8J2, GB8917P8JT

HARDWARE SPECIFICATION




2 unit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (DEDDY DERMAWAN, S.KOM) NIP. 19911282018011002	PENGELOLA SISTEM DATA User Representatives  (ELLIA S. SIMONING) NIP. 199307092018032002	Service Engineer  (ARASIS JEJEN) PT. Arasis Infirco
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 12/i/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name :
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	PEMELIHARAAN PERANGKAT
Location : <u>Gd. II Lt.11 R. Server</u>	PENDUKUNG DATA CENTER DAN DRC
Date : <u>4/1/2024</u>	BADAN KEPEGAWAIAN NEGARA

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPER	SERIAL NUMBER
1	Server Database	HP DL580G7	SGH3373VBC

HARDWARE SPECIFICATION

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPETENSI PERTAMA Customers Representative  (<u>DEDDY DERMAWAN, S KOM</u>) NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (<u>ELINA S SIMATUPANG</u>) NIP. 1993072463011001	Service Engineer  (<u>PT. Arasis Infirco</u>)
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 13/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>4/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Vicon	IBM System x3250M4	06XDC28

HARDWARE SPECIFICATION

--

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Cneck Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

--

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (<u>DEDDY DERMAWAN, S.KOM</u>) NIP. 19911282018011002	PENGELOLA SISTEM DATA User Representatives  (<u>ELINA S SIHOMBING</u>) NIP. 199307082015032002	Service Engineer  (_____) PT. Arasis Infirco
--	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 14/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Server</u>	
Date : <u>4/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Aplikasi	IBM System x3550M4	06AFCAH

HARDWARE SPECIFICATION

--




DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
1	Check Operational	CPU	Ok	
		HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

--

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customer's Representative	SIS User Representatives	Service Engineer
 (DEDDY DERMAWAN, S KOM) NIP. 19911282018011002	 (ELINA S SIHOMBING) NIP. 199307082015032002	 () PT. Arasis Infirco

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 15/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>4/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	--

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Aplikasi Inspektorat	IBM System x3250M4	06MWGA6

HARDWARE SPECIFICATION

--

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

--

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (<u>DEDDY.DERMAWAN.S.KOM</u>) NIP. 19911282018041002	PENYELenggara SISTEM DAN JARINGAN User Representatives  (<u>ELINA S. SIMONING</u>) NIP. 199307082015032002	Service Engineer  (<u>PT. Arasis Infirco</u>)
--	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 16/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>4/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	--

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Aplikasi Status	IBM System x3250M5	06ELLPZ

HARDWARE SPECIFICATION

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
1	Check Operational	CPU	Ok	
		HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  ELINA S. SIMONING NIP. 199307052018001002	Service Engineer  PT. Arasis Infirco
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 17/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>4/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server TV Media Humas	IBM System x3400M3	99A9965

HARDWARE SPECIFICATION	

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

--

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (DEDDY DERMAWAN, S.KOM) NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (ELINA S SIHOMING) NIP. 199307052018032002	Service Engineer  (PT. Arasis Infirco)
--	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 18/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Server</u>	
Date : <u>4/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Wasdal	HP Proliant DL380G5	CZC9164HSG

HARDWARE SPECIFICATION

--




DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

--

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  DEDDY DERMAWAN, S.KOM (NIP. 19911282018011002)	SISTEM REPRESENTATIF User Representatives  ELINA S SINOMBING NIP. 199307082018032002	Service Engineer  ARASIS DEJEN PT. Arasis Infirco
--	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 19/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>4/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Biometrik	HP Proliant DL380G8	SGH316T0T4




HARDWARE SPECIFICATION	

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative	SISTEM DAN PERANGKAT User Representatives	Service Engineer
 (DEDDY DERMAWAN, S.KOM NIP. 19911282018011002)	 (ELINA S SITORO NIP. 1993070820015032702)	 (PT. Arasis Infirco)

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 20/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name :
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	PEMELIHARAAN PERANGKAT
Location : <u>Gd. II Lt.11 R. Server</u>	PENDUKUNG DATA CENTER DAN DRC
Date : <u>4/1/2024</u>	BADAN KEPEGAWAIAN NEGARA

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Server Backup Application	HP Proliant DL380pG8	SGH3373VBA

HARDWARE SPECIFICATION

--

DETAILS OF WORK CARRIED OUT


No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean Unit from dust	Ok		Checked 4/1/2024

--

REMARKS

--

NAME AND SIGNATURE

PRANATA KOMPETEN PERTAMA Customers Representative  (<u>DEDDY DERMAWAN, S.KOM</u>) NIP. 19911282018011002	SIS User Representatives  (<u>ELINA S. SIHOMBING</u>) NIP. 199307082015032002	Service Engineer  (<u>ARASIS DEJEN</u>) PT. Arasis Infirco
---	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 21/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11</u> Date : <u>5/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Switch 24 Ports Gd. II Lt. 11	HP ProCurve Switch 2620-24	

HARDWARE SPECIFICATION

HP 2620-24-PoE+ Switch (J9624A)
 12 RJ-45 autosensing 10/100 ports (IEEE 802.3 Type 10BASE-T, IEEE 802.3u Type 100BASE-TX)
 Media Type: Auto-MDIX
 Duplex: half or full
 12 RJ-45 autosensing 10/100 PoE+ ports (IEEE 802.3 Type 10BASE-T, IEEE 802.3u Type 100BASE-TX, IEEE 802.3at PoE+)
 1 RJ-45 serial console port
 4 unit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
		Net	Ok	
2	Check Hardware Fault		Ok	
3	Check Power Supply		Ok	
4	Check Cleaning & Dusting		Ok	Checked 5/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPETEN PERTAMA Customers Representative  (<u>EDDY DERMAWAN, S.KOM</u>) NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (<u>ELINA S. SIHOMBING</u>) NIP. 199207082015032002	Service Engineer  (<u>ARMIT</u>) PT. Arasis Infirco
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 22/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11</u> Date : <u>5/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Switch 48 Ports Gd. II Lt. 11	HP ProCurve Switch 2810-48G	CN903XJ01Y, CN102XJ03T

HARDWARE SPECIFICATION


HP ProCurve Switch 2810-48G, 44 port 10/100/1000, 4 dual ports
 Throughput up to 71.4 Mpps. Switching capacity: 96Gbps
 mini-GBIC Gigabit-SX, LC connection
 Allows dual connection between 2 Procurve 2810-48G switches in Central and each Main Switch

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
		Net	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 5/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER BERTAMA Customers Representative  (EDDY DERMAWAN, S.KOM) NIP. 19911282018011002	PENGELOLA SISTEM DAN PERANGKAT User Representatives  (ELINA S SIMONING) NIP. 199307062013032002	Service Engineer  (ARASIS) Arasis PT. Arasis Infirco
--	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 23/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11 R. Server</u> Date : <u>5/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	--

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Switch 48 Port Datacenter	HP ProCurve Switch 2810-48G	CN903XJ08Q, CN907XJOCT

HARDWARE SPECIFICATION

HP ProCurve Switch 2810-48G, 44 port 10/100/1000, 4 dual ports
 Throughput up to 71.4 Mpps. Switching capacity: 96Gbps
 mini-GBIC Gigabit-SX, LC connection
 Allows dual connection between 2 Procurve 2810-48G switches in Central and each Main Switch

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
		Net	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 5/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Customers Representative (<u>EDDY DERMAWAN, S.KOM</u>) NIP. 19911282018011002	PENGELOLA User Representatives (<u>ELINA S. SIHOMBING</u>) NIP. 199307032013032002	Service Engineer (<u>ARASIS</u>) PT. Arasis Infirco
---	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 24/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R. UPS</u>	
Date : <u>9/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	Precision/D.F Air Conditioner CITEC		
2	Air Conditioner Split 2PK	2	v
3	Precision Air Conditioner		
4	AC Condenser		
5	AC Split NOC		
6	AC Split Utility		

MERK / TYPE

AC / SPLIT 2PK

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Room Temperature	Ok	
2	Check Pressure Control Valve	Ok	
3	Clean Air Filter and Condenser	Ok	Checked 9/1/2024
4	Monitoring Unit	Ok	

REMARKS

Perbaiki pada saluran drain (air pembuangan)

NAME AND SIGNATURE

Authorized PRANATA KOMPUTER PERTAMA Customers Representative	User Representatives SISTEM DAN JARINGAN	Service Engineer
 DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	 ELMA S SIHOMBING NIP. 199307062013032002	 Soeranto PT. Arasis Infirco

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 25/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Datacenter</u>	
Date : <u>10/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	Precision/D.F Air Conditioner CITEC		
2	Air Conditioner Split 2PK		
3	Precision Air Conditioner	1	√
4	AC Condenser		
5	AC Split NOC		
6	AC Split Utility		




MERK / TYPE
Climaveneta Cool Blade SAU045, SN: 0161200916

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Panel Display / alarm Status	Ok	
2	Check Temp. Room	Ok	Room Temperature 19 - 21 °C
3	Check I/O Voltage, Load Amp.	Ok	in:380v, R=24,4A, T=24,4A, S=24,4A
4	Clean Air Filter and Condenser	Ok	Checked 10/1/2024

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPUTER PERTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives PENGELOLA SISTEM DAN JARINGAN  ELINA S. SINGSING NIP. 199307002018032002	Service Engineer  S. SEKANTO PT. Arasis Infirco
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 26/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN) Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640 Location : Gd. II Lt.11 R. Datacenter Date : 10/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	Precision/D.F Air Conditioner CITEC		
2	Air Conditioner Split 2PK		
3	Precision Air Conditioner		
4	AC Condenser	1	√
5	AC Split NOC		
6	AC Split Utility		




MERK / TYPE
 AC Condenser MC-120 BARCODE: 1170100160105

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Panel Display / alarm Status	Ok	
2	Clean Air Filter and Condenser	Ok	Checked 10/1/2024
3	Check I/O Voltage, Load Amp.	Ok	

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPUTER PERTAMA Customers Representative  DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  ELINA S SINGHING NIP. 199307062019030001	Service Engineer  SOE PT. Arasis Infirco
--	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 27/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt. 11 R. NOC</u>	
Date : <u>12/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	Precision/D.F Air Conditioner CITEC		
2	Air Conditioner Split 2PK		
3	Precision Air Conditioner		
4	AC Condenser		
5	AC Split NOC	2	√
6	AC Split Utility		




MERK / TYPE
 DAIKIN / SPLIT 2PK / SN : K028204, K029887

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Room Temperature	Ok	
2	Check Pressure Control Valve	Ok	
3	Clean Air Filter and Condenser	Ok	Checked 12/1/2024
4	Monitoring Unit	Ok	

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  ELINA S SIMOMBING NIP. 199307012018012001	Service Engineer  ARASIS Armint PT. Arasis Infirco
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 28/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Utility</u>	
Date : <u>12/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	Precision/D.F Air Conditioner CITEC		
2	Air Conditioner Split 2PK		
3	Precision Air Conditioner		
4	AC Condenser		
5	AC Split NOC		
6	AC Split Utility	2	√

MERK / TYPE
 DAIKIN / SPLIT 2PK / SN : K027262, K027250

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Room Temperature	Ok	
2	Check Pressure Control Valve	Ok	
3	Clean Air Filter and Condenser	Ok	Checked 12/1/2024
4	Monitoring Unit	Ok	

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  DEDDY DERMAWAN, S.KOM. NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  ELINA S. SIBONDING NIP. 199307082018032002	Service Engineer  ARASIS PT. Arasis Infirco
---	---	---

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 29/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R.PANEL LISTRIK</u>	
Date : <u>16/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)	1	√	9	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
2	MDP UPS (MCCB 3P 63A(8))						
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))						
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))						
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))						
6	UPS 20KVA DC						
7	UPS APC SUJVT 30KVA 400V w/3 BA1T EXP TO 4						

MERK / TYPE	MOTORIZED BREAKER \ BOX PANEL 120cm X 80cm X 30cm
-------------	---

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	Check Output Power Load	OK	
2	Check breaker For Cracking and buzzing noise	OK	
3	Check Open / Closed Circuit	OK	
4	Monitoring Unit	OK	Checked 16/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KAMTORISERTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives PENGELOLA SISTEM DAN JARINGAN  ELINA S. SIREGAR NIP. 19930700201010002	Service Engineer  EDDY DERMAWAN PT. Arasis Infirco
---	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 30/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN) Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640 Location : Gd. III Lt.D R.PANEL LISTRIK Date : 16/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
2	MDP UPS (MCCB 3P 63A(8))	2	√				
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))						
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))						
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))						
6	UPS 20KVA DC						
7	UPS APC.SUVT 30KVA 400V w/3 BATT EXP TO 4						

MERK / TYPE

(MCCB 3P 63A(8)) / BOX PANEL 170cm X 100cm X 60cm

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	Check all Output Power Load	OK	
2	Inspect for hissing, cracking and buzzing noise	OK	
3	Inspect for loose, broken, and missing parts	OK	
4	Clean from Insulating Dust and materials	OK	Checked 16/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	PRATIPLA SISTEM DAN JARINGAN User Representatives (ELINA SINOUBING NIP. 199307062195000002)	Service Engineer ARASIS Soekarno PT. Arasis Infirco
---	---	--

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 31/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R.PANEL LISTRIK</u>	
Date : <u>16/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
2	MDP UPS (MCCB 3P 63A(8))						
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))	2	√				
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))						
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))						
6	UPS 20KVA DC						
7	UPS APC SUVT 30KVA 400V w/3 BATT EXP TO 4						

MERK / TYPE
 (MCCB 3P 63A(1) MCB 3P 16A(8)) / BOX PANEL 70cm X 50cm X 25cm

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	Check all Output Power Load	OK	
2	Inspect for hissing, cracking and buzzing noise	OK	
3	Inspect for loose, broken, and missing parts	OK	
4	Clean from Insulating Dust and materials	OK	Checked 16/1/2024

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPYUTER PRATAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (ELINA S. GUNANINGRUM) NIP. 199207012015022002	Service Engineer  Soeharto PT. Arasis Infirco
--	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 32/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11</u> Date : <u>18/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPER	SERIAL NUMBER
1	Rack Switch	COMMSCOPE 15U	

HARDWARE SPECIFICATION




Rack Switch 15 U
 23 UNIT

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		FAN	Ok	
1	Check Operational	Led	Ok	
2	Check Hardware Fault		Ok	
3	Check Cleaning & Dusting		Ok	Checked 18/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPETENSI TMA Authorized Customers Representative	PENGELOLA SIS User Representatives	Service Engineer
 (<u>BEDDY DERMAWAN, S.KOM</u> NIP. 19911282018011002)	 (<u>ELINA S. SIHOMBING</u> NIP. 199307032015032008)	 (<u>ARASIS</u> Arasis) PT. Arasis Infirco

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 33/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11</u> Date : <u>18/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	--

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Switch Dell	Dell C1048P	

HARDWARE SPECIFICATION




DELL C1048P
 48 10/100/1000BASE-T RJ45 PoE+
 2 integrated SFP+ uplink ports
 2 integrated 21Gbps stack ports
 Console/management port with RS232 signaling
 23 UNIT

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		FAN	Ok	
1	Check Operational	Led	Ok	
2	Check Hardware Fault	Ok		
3	Check Cleaning & Dusting	Ok		Checked 18/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPETENSI PERTAMA Authorized Customers Representative  (<u>EDDY DERMAWAN, S KOM</u>) NIP. 19911282018011002	PRANIKAH SISTEM DAN JARINGAN User Representatives  (<u>ELINA S SINOMENG</u>) NIP. 199307062016032602	Service Engineer  (<u>ARASIS</u>) Arasis PT. Arasis Infirco
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 34/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11</u>	
Date : <u>18/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Patch Panel 48 Port	COMMSCOPE CAT6	

HARDWARE SPECIFICATION




Patch Panel 48 Port
23 UNIT

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Operational	OK	
2	Check Hardware Fault	Ok	
3	Check Cleaning & Dusting	Ok	Checked 18/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (<u>BEDDY DERMAWAN, S.KOM</u>) NIP. 19911282018011002	PENGELOLA SISTEM DAN JARINGAN User Representatives  (<u>ELINA S SINOMBING</u>) NIP. 198307092016022002	Service Engineer  (<u>ARASIS</u>) Armit PT. Arasis Infirco
---	--	---

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 35/I/SR-AI/2024

DETAILS OF CUSTOMER	
Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>R. GENSET</u>	
Date : <u>19/1/2024</u>	

DETAILS OF EQUIPMENTS							
NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA		
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTAA855-G7A 400KVA	1	✓
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader		
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV		
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))			13	Fire Alarm		
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))			14			
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA						

MERK / TYPE
 CUMMINS NTAA855-G7A 400KVA, SN: VG18145005

DETAILS OF WORK CARRIED OUT			
No	Detail of Work	status	Note
1	CHECK LED STATUS ON MANUAL TEST	OK	
2	CHECK OIL, BATT, RADIATOR AND FUEL	OK	
3	PERFORM MANUAL ENGINE START	OK	
4	SET TO AUTO START AND MONITORING	OK	Checked 19/1/2024

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPUTER PERTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives PENGELOLA SISTEM DAN JARINGAN  ELINA S SINOMBING NIP. 198307082015032002	Service Engineer  ARASIS Soekanto PT. Arasis Infirco
---	---	---

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 36/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R. UPS</u>	
Date : <u>23/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA		
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader		
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV		
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(5))			13	Fire Alarm		
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))			14	UPS GTEC 20KVA	1	√
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA						

MERK / TYPE

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	PERFORM MECHANICAL/ELECTRICAL INSPECTION	OK	
2	CHECK ALARM LOGS	OK	
3	CHECK BATTERY STATUS	OK	
4	CLEAN UNIT FROM DUST	OK	Checked 23/1/2024

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPTIK & ESTAMA Customer's Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  ELINA S SINORRING NIP. 199307052015032002	Service Engineer  ARASIS Subit Arasis PT. Arasis Infirco
--	--	--

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 37/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R. UPS</u>	
Date : <u>23/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA		
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTA855-G7A 400KVA		
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader		
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV		
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))			13	Fire Alarm		
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))						
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA	6	√				

MERK / TYPE /SN : APC / SUVTP30KH3B4S



DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	PERFORM MECHANICAL/ELECTRICAL INSPECTION	OK	
2	CHECK ALARM LOGS	OK	
3	CHECK BATTERY STATUS	OK	
4	CLEAN UNIT FROM DUST	OK	Checked 23/1/2024

REMARKS

Diperlukan penggantian battery, karena sudah tidak bisa menyimpan daya

NAME AND SIGNATURE

Authorized PRANATA KOMPUTER PERTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives PERUSAHAAN SISTEM DAN JARINGAN  ELINA S. SIHOMBING NIP. 199307022012032302	Service Engineer  ARASIS Soeranto PT. Arasis Infirco
---	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 38/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R. UPS</u>	
Date : <u>23/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA	1	√
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader		
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV		
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))			13	Fire Alarm		
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))						
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA						

MERK / TYPE / SN :




SENDON / EA8980 / 890801510200004

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	PERFORM MECHANICAL / ELECTRICAL INSPECTION	OK	
2	CHECK ALARM LOGS	OK	
3	CHECK BATTERY STATUS	OK	
4	CLEAN UNIT FROM DUST	OK	Checked 23/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KONTAK PERTAMA Customers Representative  DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (ELINA S. SINGOMBING) NIP. 199307032015032002	Service Engineer  ARASIS SO ERMA PT. Arasis Infirco
--	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 39/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. III Lt.D R.PANEL LISTRIK</u>	
Date : <u>24/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
2	MDP UPS (MCCB 3P 63A(8))						
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))						
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))	8	√				
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))						
6	UPS 20KVA DC						
7	UPS APC SUVT 30KVA 400V w/3 BATT EXP TO 4						

MERK / TYPE


(MCCB 3P 63A(1) MCB 3P 16A(6)) / BOX PANEL 60cm X 40cm X 20cm

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	Check all Output Power Load	OK	
2	Inspect for hissing, cracking and buzzing noise	OK	
3	Inspect for loose, broken, and missing parts	OK	
4	Clean from Insulating Dust and materials	OK	Checked 24/1/2024

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPUTER PERTAMA Customer's Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives PENGELOLA SISTEM DAN JARINGAN  ELINA S. SIHOMBING NIP. 199307082018032002	Service Engineer  ARASIS Soeranto PT. Arasis Infirco
---	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 40/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN) Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640 Location : Gd.I , G.II, G.III Date : 24/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
2	MDP UPS (MCCB 3P 63A(8))						
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))						
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))						
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))	17	√				
6	UPS 20KVA DC						
7	UPS APC SUVT 30KVA 400V w/3 BATT EXP TO 4						




MERK / TYPE
 (MCB 3P 16A(1), MCB 1P 10A(6)) / BOX PANEL 40cm X 30cm X 17cm

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	Check all Output Power Load	OK	
2	Inspect for hissing, cracking and buzzing noise	OK	
3	Inspect for loose, broken, and missing parts	OK	
4	Clean from Insulating Dust and materials	OK	Checked 24/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPYUTER PERTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DATA JARINGAN  (ELINA S SINOUBING) NIP. 199307092019032002	Service Engineer  ARASIS Soeharto PT. Arasis Infirco
--	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 53/I/SR-Ai/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>Gd. II Lt.11 R. Utility</u>	
Date : <u>29/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
2	MDP UPS (MCCB 3P 63A(8))						
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))						
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))						
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))						
6	UPS GTEC 30KVA	1	√				
7	UPS APC SUVT 30KVA						




MERK / TYPE /SN

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	PERFORM MECHANICAL/ELECTRICAL INSPECTION	OK	
2	CHECK ALARM LOGS	OK	
3	CHECK BATTERY STATUS	OK	
4	CLEAN UNIT FROM DUST	OK	Checked 29/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KCS Authorized Customers Representative  DEDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives  ELINA S SIHOMBING NIP. 199307032016023002	Service Engineer  ARASIS PT. Arasis Infirco
--	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 54/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN) Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640 Location : Gd. II Lt.11 Date : 29/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA		
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader	6	v
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV		
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))			13	Fire Alarm		
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))						
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA						

MERK / TYPE / SN
 Access Control Reader, R. Utility(1), R.Network(1), R.NOC(1), Lorong NOC Server(1), R.Server (2Unit)

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Login	Ok	
2	CLEAN UNIT FROM DUST	Ok	
3	Monitoring Unit	Ok	Checked 29/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KONTAK UTAMA Authorized Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	USER REPRESENTATIVES SISTEM DATA MANAJEMEN  ELINA S SIHOMBING NIP. 19930709030418032002	Service Engineer  ARASIS PT. Arasis Infirco
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 55/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN) Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640 Location : Gd. II Lt. 11 Date : 29/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA		
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader		
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV	11	✓
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))			13	Fire Alarm		
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))						
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA						



MERK / TYPE /SN :
 DAHUA type IPC-HDW1220S

DETAILS OF WORK CARRIED OUT

No	Detail of Work	statu	Note
1	CLEAN UNIT FROM DUST	OK	
2	MONITORING UNIT	OK	Checked 29/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KELOMPOK PERTAMA Authorized Customers Representative  BEDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (ELINA G SIHOMBING) NIP. 199307062015032003	Service Engineer  ARASIS PT. Arasis Infirco
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 56/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11</u> Date : <u>29/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	Panel AMF/ATS Motorized Breaker 400A(2)			9	UPS SENDON 3P 3:3 80 KVA		
2	MDP UPS (MCCB 3P 63A(8))			10	GENSET CCEC CUMMINS NTAA855-G7A 400KVA		
3	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(8))			11	Access Control Reader		
4	SDP UPS (MCCB 3P 63A(1) MCB 3P 16A(6))			12	CCTV		
5	PP UPS (MCCB 3P 63A(1), MCB 1P 10A(6))			13	Fire Alarm	1	✓
6	PP UPS (MCB 3P 16A(1), MCB 1P 10A(6))						
7	UPS 20KVA DC						
8	UPS APC SUVT 30KVA						




MERK / TYPE /SN :
 FIRE ALARM NFS2-320

DETAILS OF WORK CARRIED OUT

No	Detail of Work	statu	Note
1	PERFORM MECHANICAL/ELECTRICAL INSPECTION	OK	
2	CHECK ALARM LOGS	OK	Checked 29/1/2024
3	CHECK BATTERY STATUS	OK	
4	CLEAN UNIT FROM DUST	OK	Checked 29/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPETEN PERTAMA Authorized Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	User Representatives SISTEM DAN JARINGAN  (ELMA S SINOMBING) NIP. 198307082015032002	Service Engineer  ARASIS S. W. A. PT. Arasis Infirco
--	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 57/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>Gd. II Lt.11</u> Date : <u>29/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
--	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Access Point	ARUBA W-AP325	

HARDWARE SPECIFICATION

5 GHz (1,733 Mbps max rate) and 2.4 GHz (800 Mbps max rate) radios.
 each with 4x4 MIMO support and a total of eight integrated omni-directional downtilt antennas
 AP type: Indoor, dual radio, 5 GHz 802.11ac and 2.4 GHz 802.11n 4x4 MIMO
 Software-configurable dual radio supports 5 GHz (Radio 0) and 2.4 GHz (Radio 1)
 Maximum (worst-case) power consumption: 20W (802.3at PoE), 13.5W (802.3af PoE) or 18.5W (DC)
 85 UNIT

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		LED	Ok	
1	Check Operational			
2	Check Hardware Fault		Ok	
3	Check Cleaning & Dusting		Ok	Checked 29/1/2024

REMARKS

Penggantian instalasi kabel di Gd.2 Lt.6

NAME AND SIGNATURE

PENGELOLA

PRANATA KOMUNIKASI PERTAMA
 Customers Representative

User Representatives

Service Engineer

(EDDY DERMAWAN, S.KOM)
 NIP. 19911282018011002

(ELINA S SINCISING)
 NIP. 1993072002014022002

(PT. Arasis Infirco)

DISASTER RECOVERY CENTER

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 41/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>R. Server DRC Pusbang Ciawi</u> Date : <u>26/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPER	SERIAL NUMBER
1	Switch 48 Ports	HP ProCurve Switch 2530-48G	CN52FP61P8

HARDWARE SPECIFICATION




HP ProCurve Switch 2530-48G, 44 port 10/100/1000, 4 dual ports
 Throughput up to 71.4 Mpps. Switching capacity: 96Gbps
 mini-GBIC Gigabit-SX, LC connection

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (EDDY DERMAWAN, S.KOM NIP. 19911282018011002)	SISTEM BINA User Representatives  (EDDY DERMAWAN NIP. 19911282018011002)	Service Engineer  (ARASIS PT. Arasis Infirco)
--	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 42/1/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>R. Server DRC Pusbang Ciawi</u>	
Date : <u>26/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Router	HP HSR6602-G Router	CN4BFRW019

HARDWARE SPECIFICATION




HP HSR6602-G Router
 HP 5800 300W AC Power Supply
 HP X421 Chassis Universal Rck Mntg Kit

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
		Net	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (EDDY DERMAWAN, S.KOM) NIP. 19911282018011002	SISTEM DAN PERANGKAT User Representatives  (ELINA S SIHOMBING) NIP. 19830702015032002	Service Engineer  (ARASIS) PT. Arasis Infirco
--	--	---

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 43/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>R. Server DRC Pusbang Ciawi</u> Date : <u>26/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Load Balancer	f5 BIG IP 2000s	f5-bsrg-onmz

HARDWARE SPECIFICATION




BIG-IP 2000s Local Traffic Manager (8 GB Memory, Max SSL, Max Compression)-(1)
 BIG-IP Single AC Power Supply for 2X00s (400 W, Field Upgrade)-(1)

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		Port	Ok	
1	Check Operational	Led	Ok	
		Net	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Check Cleaning & Dusting	Ok		Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

Authorized Customers Representative  DEDDY DERMAWAN, S.KOM (NIP. 19911282018011002)	User Representative  ELINA S SIMONING (NIP. 199307092018032002)	Service Engineer  ARASIS PT. Arasis Infirco
---	---	---

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 44/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>R. Server DRC Pusbang Ciawi</u> Date : <u>26/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Database Server 1	HP PROLIANT DL580G9	SGH529YY1B

HARDWARE SPECIFICATION	
ProLiant DL580 G9 Intel Xeon Quad Core E7330 Rackmount 4U, 4 GB PC2-5300R registered ECC SDRAM 2 Xeon Quad Core E7330 processors (each one 4x2.4 GHz 64 bit Cores / 2 x 3MB L2 cache/ 80W), max 4 processors (16 cores) Includes dual LAN NC371i 10/100/1000TX and DVD-ROM drive 800/1200W AC Power Supply 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm RAID1 Mirror, for cluster operating system and database application 128 GB RAM	

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPUTER PERTAMA Authorized Customers Representative  (<u>DEDDY DERMAWAN, S.KOM</u>) NIP. 19911282018011002	SISTEM MANAJEMEN User Representatives  (<u>ELINA S SHOMBING</u>) NIP. 199307082015032002	Service Engineer  (<u>PT. Arasis Infirco</u>)
---	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 45/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>R. Server DRC Pusbang Ciawi</u> Date : <u>26/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	--

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Application Server 1	HP PROLIANT DL380G9	SGH529YY1J

HARDWARE SPECIFICATION



ProLiant DL380 G9 Xeon Quad Core E5-2609 v2 Rackmount 2U, Advanced ECC Fully Buffered DDR-3 1333 MHz RAM
 4x2.50 GHz 64 bit cores / 12MB (2 x 6MB) cache/ 1333 MHz FSB
 Includes dual LAN NC373i 10/100/1000TX
 Redundant Power Supply 350/370/380 G5 Kit
 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm
 2 disks per server RAID1 Mirror, for operating system. Common applications are stored in SAN
 96 GB RAM

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

Authorized Customers Representative  (<u>BEDDY DERMAWAN, S.KOM</u> NIP. 19911282018011002)	PENCELOLA (<u>ELINA S SIMOMBING</u> NIP. 199307052018032002)	Service Engineer  (<u>ARASIS</u> PT. Arasis Infirco)
--	--	--

PT. Arasis Infirco

Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 46/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>R. Server DRC Pusbang Ciawi</u> Date : <u>26/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	MERK/TYPE	SERIAL NUMBER
1	Application Server 2	HP PROLIANT DL380G9	SGH529YY1F

HARDWARE SPECIFICATION




ProLiant DL380 G9 Xeon Quad Core E5-2609 v2 Rackmount 2U, Advanced ECC Fully Buffered DDR-3 1333 MHz RAM
 4x2.50 GHz 64 bit cores / 12MB (2 x 6MB) cache/ 1333 MHz FSB
 Includes dual LAN NC373i 10/100/1000TX
 Redundant Power Supply 350/370/380 G5 Kit
 72GB 2.5" Small Form Factor Serial Attached SCSI hot-plug 10.000rpm
 2 disks per server RAID1 Mirror, for operating system. Common applications are stored in SAN
 96 GB RAM

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status		Note
		CPU	Ok	
1	Check Operational	HDD	Ok	
		RAM	Ok	
2	Check Hardware Fault	Ok		
3	Check Power Supply	Ok		
4	Clean unit from dust	Ok		Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

Authorized Customers Representative  (<u>BEDDY DERMAWAN, S.KOM</u> (NIP. 19911282018011002))	PENGELOLA User Representatives  (<u>ELINA S SIHOMBING</u> (NIP. 199307002012003000))	Service Engineer  (<u>ARASIS</u> (PT. Arasis Infirco))
---	---	--

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 47/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u>	
Location : <u>R. Server DRC Pusbang Ciawi</u>	
Date : <u>26/1/2024</u>	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	Precision/D.F Air Conditioner Liebert	1	v



MERK / TYPE
Liebert / PAC P1020 DA13C / LSF32 sn: 210F0112369215501000A, 21F01123692155010009

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Panel Display / alarm Status	Ok	
2	Check Pressure Control Valve	Ok	Room Temperature on 19 - 22 °C
3	Clean Air Filter and Condenser	Ok	
4	Check I/O Voltage, Load Amp.	Ok	Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPYUTER BERTAMA Authorized Customers Representative	User Representatives SISTEM DAN JARINGAN	Service Engineer
 EDDY DERMAWAN, S.KOM NIP. 19911282018011002	 ELINA S SIHOMBING NIP. 198307032013032008	 ARASIS Soetrato PT. Arasis Infirco

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 48/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN)
 Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640
 Location : R. Server DRC Pusbang Ciawi
 Date : 26/1/2024

Contract Name :
 PEMELIHARAAN PERANGKAT
 PENDUKUNG DATA CENTER DAN DRC
 BADAN KEPEGAWAIAN NEGARA

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	AC Split 1 PK	2	√
2	AC Cassete 4 PK		

MERK / TYPE

Sharp AH-A9SCY

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Room Temperature	Ok	
2	Check Pressure Control Valve	Ok	Room Temperature on 19 - 22 °C
3	Clean Air Filter and Condenser	Ok	
4	Monitoring Unit	Ok	Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPOTENSI TAMA
 Customers Representative

EDDY DERMAWAN, S.KOM
 NIP. 19911282018011002

PEMANGGILAN
 SISTEM DAN SARANAN

User Representatives

ELINA S SIHOMBING
 NIP. 199307022015002002

Service Engineer

PT. Arasis Infirco

PT. Arasis Infirco

Gedung 47 Lt. 2

Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530

Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 49/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : <u>BADAN KEPEGAWAIAN NEGARA (BKN)</u> Address : <u>Jl. Mayjend. Sutoyo No.12, Jakarta 13640</u> Location : <u>R. Server DRC Pusbang Ciawi</u> Date : <u>26/1/2024</u>	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk
1	AC Split 1 PK		
2	AC Cassete 4 PK	2	√

MERK / TYPE
Panasonic

DETAILS OF WORK CARRIED OUT

No	Detail of Work	Status	Note
1	Check Room Temperature	Ok	
2	Check Pressure Control Valve	Ok	Room Temperature on 19 - 22 °C
3	Clean Air Filter and Condenser	Ok	
4	Monitoring Unit	Ok	Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KONTAK UTAMA Customers Representative  EDDY DERMAWAN, S.KOM NIP. 19911282018011002	PENGELOLA SISTEM DATA CENTER User Representatives  ELVA S... NIP. 99000...	Service Engineer  ARASIS PT. Arasis Infirco
---	--	---

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 50/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN) Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640 Location : R.PANEL LISTRIK DRC Pusbang Ciawi Date : 26/1/2024	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
---	---

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	GENSET PERKINS 60KVA						
2	Panel AMF/ATS Motorized Breaker 400A(2)	1	V				
3	UPS LIEBERT ITA 20 KVA						
4	UPS GTEC SR20T 20KVA						

MERK / TYPE
 MOTORIZED BREAKER \ BOX PANEL 120cm X 80cm X 30cm

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	Check Output Power Load	OK	
2	Check breaker For Cracking and buzzing noise	OK	
3	Check Open / Closed Circuit	OK	
4	Monitoring Unit	OK	Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

PRANATA KOMPONEN PERTAMA Customers Representative  BEDDY DERMAWAN, S.KOM NIP. 19911282018011002	PENGUNTA User Representatives  ELINA S. SIMORANG (NIP. 199307032015032002)	Service Engineer  ARASIS Soerant PT. Arasis Infirco
--	---	--

PT. Arasis Infirco
 Gedung 47 Lt. 2
 Jl. TB. Simatupang No. 47 - Jakarta Selatan 12530
 Telp : 021-29406340, Fax : 021-78842390



SERVICE REPORT

No : 51/I/SR-AI/2024

DETAILS OF CUSTOMER

Customer : BADAN KEPEGAWAIAN NEGARA (BKN)	Contract Name : PEMELIHARAAN PERANGKAT PENDUKUNG DATA CENTER DAN DRC BADAN KEPEGAWAIAN NEGARA
Address : Jl. Mayjend. Sutoyo No.12, Jakarta 13640	
Location : R. GENSET DRC Pusbang Ciawi	
Date : 26/1/2024	

DETAILS OF EQUIPMENTS

NO	NAME OF EQUIPMENTS	QTY	Chk	NO	NAME OF EQUIPMENTS	QTY	Chk
1	GENSET PERKINS 60KVA						
2	Panel AMF/ATS Motorized Breaker 400A(2)						
3	UPS LIEBERT ITA 20 KVA						
4	UPS GTEC SR20T 20KVA	1	v				




MERK / TYPE

DETAILS OF WORK CARRIED OUT

No	Detail of Work	status	Note
1	PERFORM MECHANICAL/ELECTRICAL INSPECTION	OK	
2	CHECK ALARM LOGS	OK	
3	CHECK BATTERY STATUS	OK	
4	CLEAN UNIT FROM DUST	OK	Checked 26/1/2024

REMARKS

NAME AND SIGNATURE

Authorized PRANATA KOMPETENSI PERTAMA Customers Representative	PENGELOLA SISTEM User Representatives	Service Engineer
 EDDY DERMAWAN, S.KOM NIP. 19911282018011002	 ELINA S SIHOMBING (NIP. 199307092016032302)	 ARASIS PT. Arasis Infirco


DOKUMENTASI



Pemeriksaan genset di BKN Pusat



Penggantian aki genset di BKN Pusat

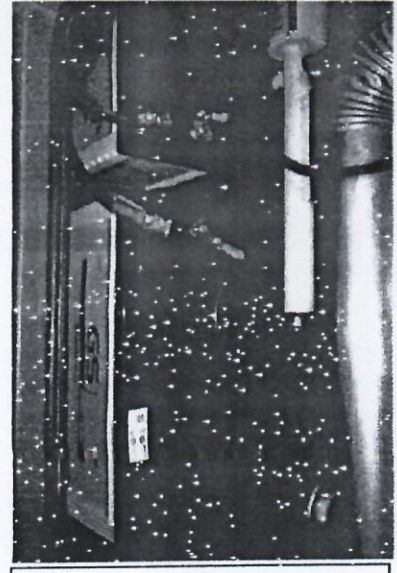

Penggantian aki genset di BKN Pusat



Perapihan instalasi jaringan lan di BKN Pusat




Perawatan di Ruang Data Center BKN Pusat




Perawatan rak switch di BKN Pusat



Perawatan PAC di BKN Pusat

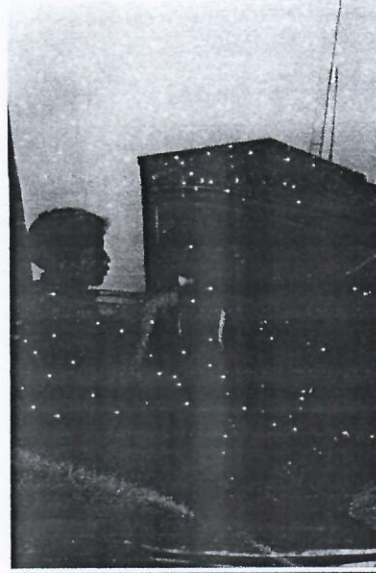

Perawatan rak switch di BKN Pusat

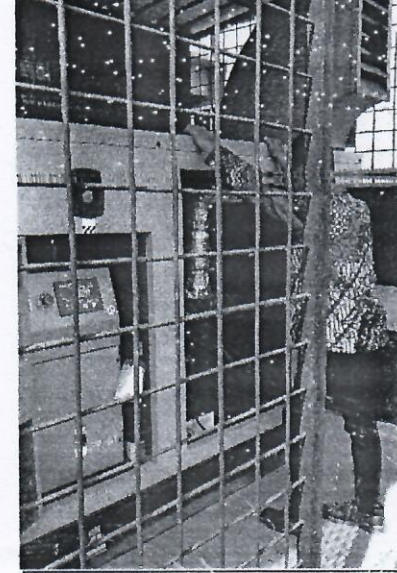

Pemeriksaan genset di BKN Pusbang



Pemeriksaan CCTV di BKN Pusat



Pemeriksaan access control di BKN Pusat



Perawatan UPS di BKN Pusat




Perawatan di Ruang Data Center BKN Pusat




Permeriksaan ATS di BKN Pusat




Perawatan AC di ruang Panel Ups

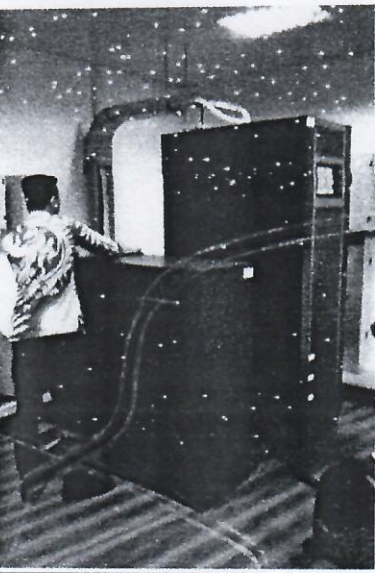


Permeriksaan UPS di ruang Utility

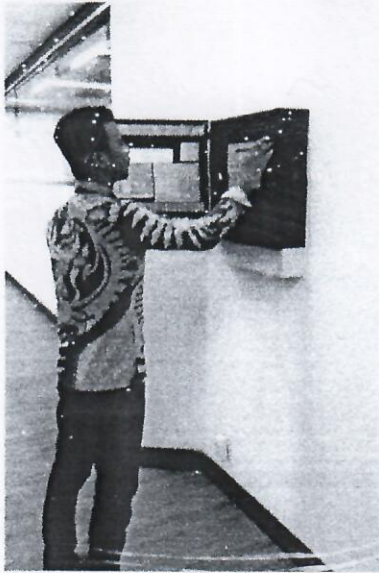

Pemeriksaan fire alarm di BKN Pusat

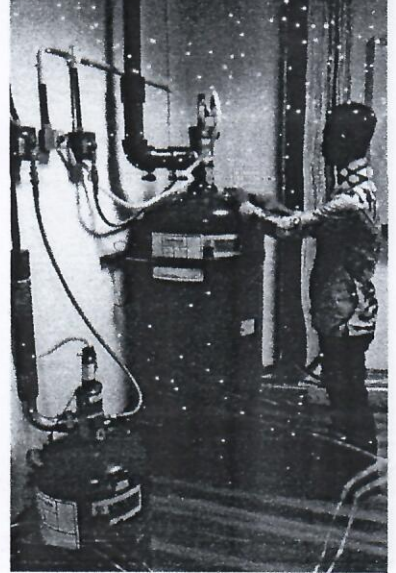

Pemeriksaan fire alarm di BKN Pusat

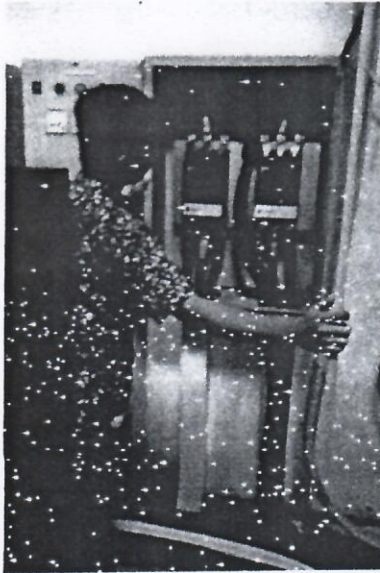


Pemeriksaan ATS di BKN Pusat



Perawatan PAC di BKN Pusbang



Pemeriksaan ATS di BKN Pusat

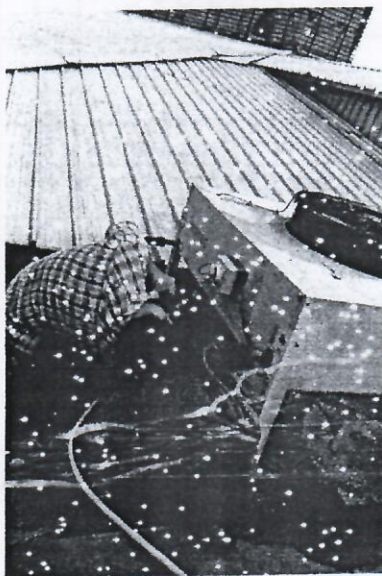


Perawatan PAC di BKN Pusat



Perawatan rak switch di BKN Pusat



Perawatan rak switch di BKN Pusat

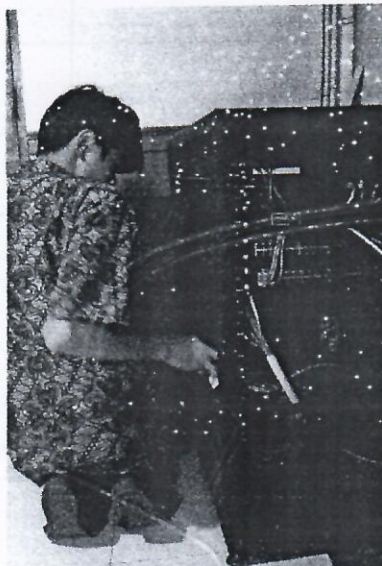

Perawatan rak switch di BKN Pusat



Perawatan AC UPS di BKN Pusat








Pemeriksaan UPS di BKN Pusbang

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI
 BADAN KEPEGAWAIAN NEGARA TAHUN 2024

TANGGAL: 3 Januari 2024






NO	NAMA	TANDA TANGAN	KETERANGAN
1.	Yusef		
2	Armin		
3	Kalis. W		
4.	Sapin		
5.	Soekanto.		

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI

BADAN KEPEGAWAIAN NEGARA TAHUN 2024

TANGGAL: 4 Jan /24






NO	NAMA	TANDA TANGAN	KETERANGAN
1.	Sufin		
2.	SOEKIRMA		
3	JEJEN		
4	Armint		
5	Kalis		

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI

BADAN KEPEGAWAIAN NEGARA TAHUN 2024

TANGGAL: 5-1-2024






NO	NAMA	TANDA TANGAN	KETERANGAN
1.	SUEKAMTO		
2.	Kalir.w		
3.	Sugiy		
4.	Armiat		
5.	YUSUF		

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI

BADAN KEPEGAWAIAN NEGARA TAHUN 2024






TANGGAL: 11 Jan '24

NO	NAMA	TANDA TANGAN	KETERANGAN
1	YUSUF		
2	Amint		
3.	Supia		
4	Kaliu		
5.	Soekanto		

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI
 BADAN KEPEGAWAIAN NEGARA TAHUN 2024

TANGGAL: 22 / 1 / 24






NO	NAMA	TANDA TANGAN	KETERANGAN
1.	Sugiy		
2	Yusuf		
3.	Soekarna		
4	Armiat		
5	Kalisu		

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI

BADAN KEPEGAWAIAN NEGARA TAHUN 2024

TANGGAL: 24 Jan' 24






NO	NAMA	TANDA TANGAN	KETERANGAN
1.	SOEKAMTO		
2.	KALIO.		
3.	Armiat		
4.	Sapig		
5.	YUSUF		

DAFTAR HADIR TENAGA AHLI

PEKERJAAN PEMELIHARAAN PERALATAN INFRASTRUKTUR TEKNOLOGI DAN INFORMASI

BADAN KEPEGAWAIAN NEGARA TAHUN 2024

TANGGAL: 21 Jan '24

NO	NAMA	TANDA TANGAN	KETERANGAN
1	Kalisu		
2.	Supri		
3	YUSUF		
4	Arniat		
5.	SOEKAMU		

PT. ARASIS INFIRCO

Gedung 47 Lt. 2

Jl. TB. Simatupang Jakarta Selatan 12530

Telp : (021) 29406340

Fax : (021) 78842390

Email : infirco@arasis.web.id

Website : www.arasis.web.id